



APPROVED FIRE LANE POSTS


(FIGURE 5-5)




TOP VIEW



TOP VIEW

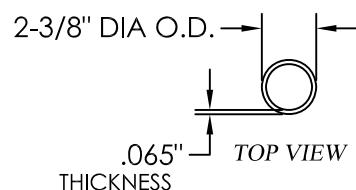


.065" THICKNESS
TOP VIEW




BACK VIEW

U-CHANNEL
POST

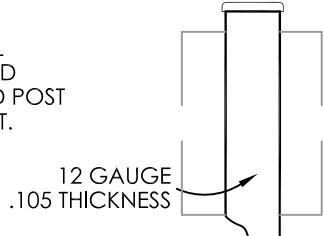


12 GAUGE
.105 THICKNESS

BACK VIEW
2" SQUARE
METAL POST

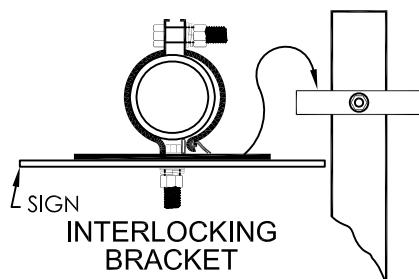

2-3/8" DIAM. ROUND
METAL POST

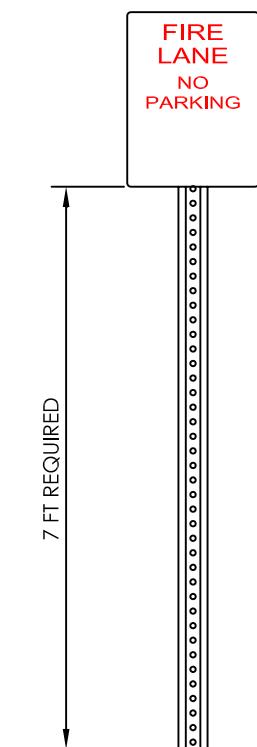

U-CHANNEL
POST

NOTES:

1. APPROVED SIGNS SHALL BE CONSTRUCTED OF .080 ALUMINUM WITH A REFLECTIVE BACKGROUND (DETAIL 1.1).
2. MINIMUM OF $\frac{1}{4}$ " BOLTS W/ FLAT WASHERS AND NUTS THAT BOLT THROUGH.
3. POST FOOTING SHALL BE 12" IN DIAM. AND 18" IN DEPTH.
4. THE SIGN SHALL BE LOCATED 7 FT FROM GRADE TO BOTTOM OF SIGN.
5. FIRE LANE SIGN SHALL BE INSTALLED 12" TO 18" FROM BACK OF CURB OR BACK OF SIDEWALK WHEN THE SIDEWALK IS ADJACENT TO THE CURB..
6. THE SIGNS SHOULD BE SET AT AN ANGLE OF NOT LESS THAN 30 DEGREES NOR MORE THAN 45 DEGREES WITH THE LINE OF TRAFFIC FLOW IN ORDER TO BE VISIBLE TO APPROACHING TRAFFIC PER THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (MUTCD).



Frederick County
Fire/Rescue Services

APPROVED FIRE LANE SIGN POSTS